


### **COMMENTARY ON WATER QUALITY**

The water supplied to the zone is classified as being moderately soft to slightly hard water, which is river/reservoir derived. As we have a grid system in place whereby we can move water around the Yorkshire region as required, occasionally the hardness of your water may vary.

No fluoride is added to the water. Any fluoride that is there is naturally occurring.

The geographical area covered by this Water Supply Zone is show below:

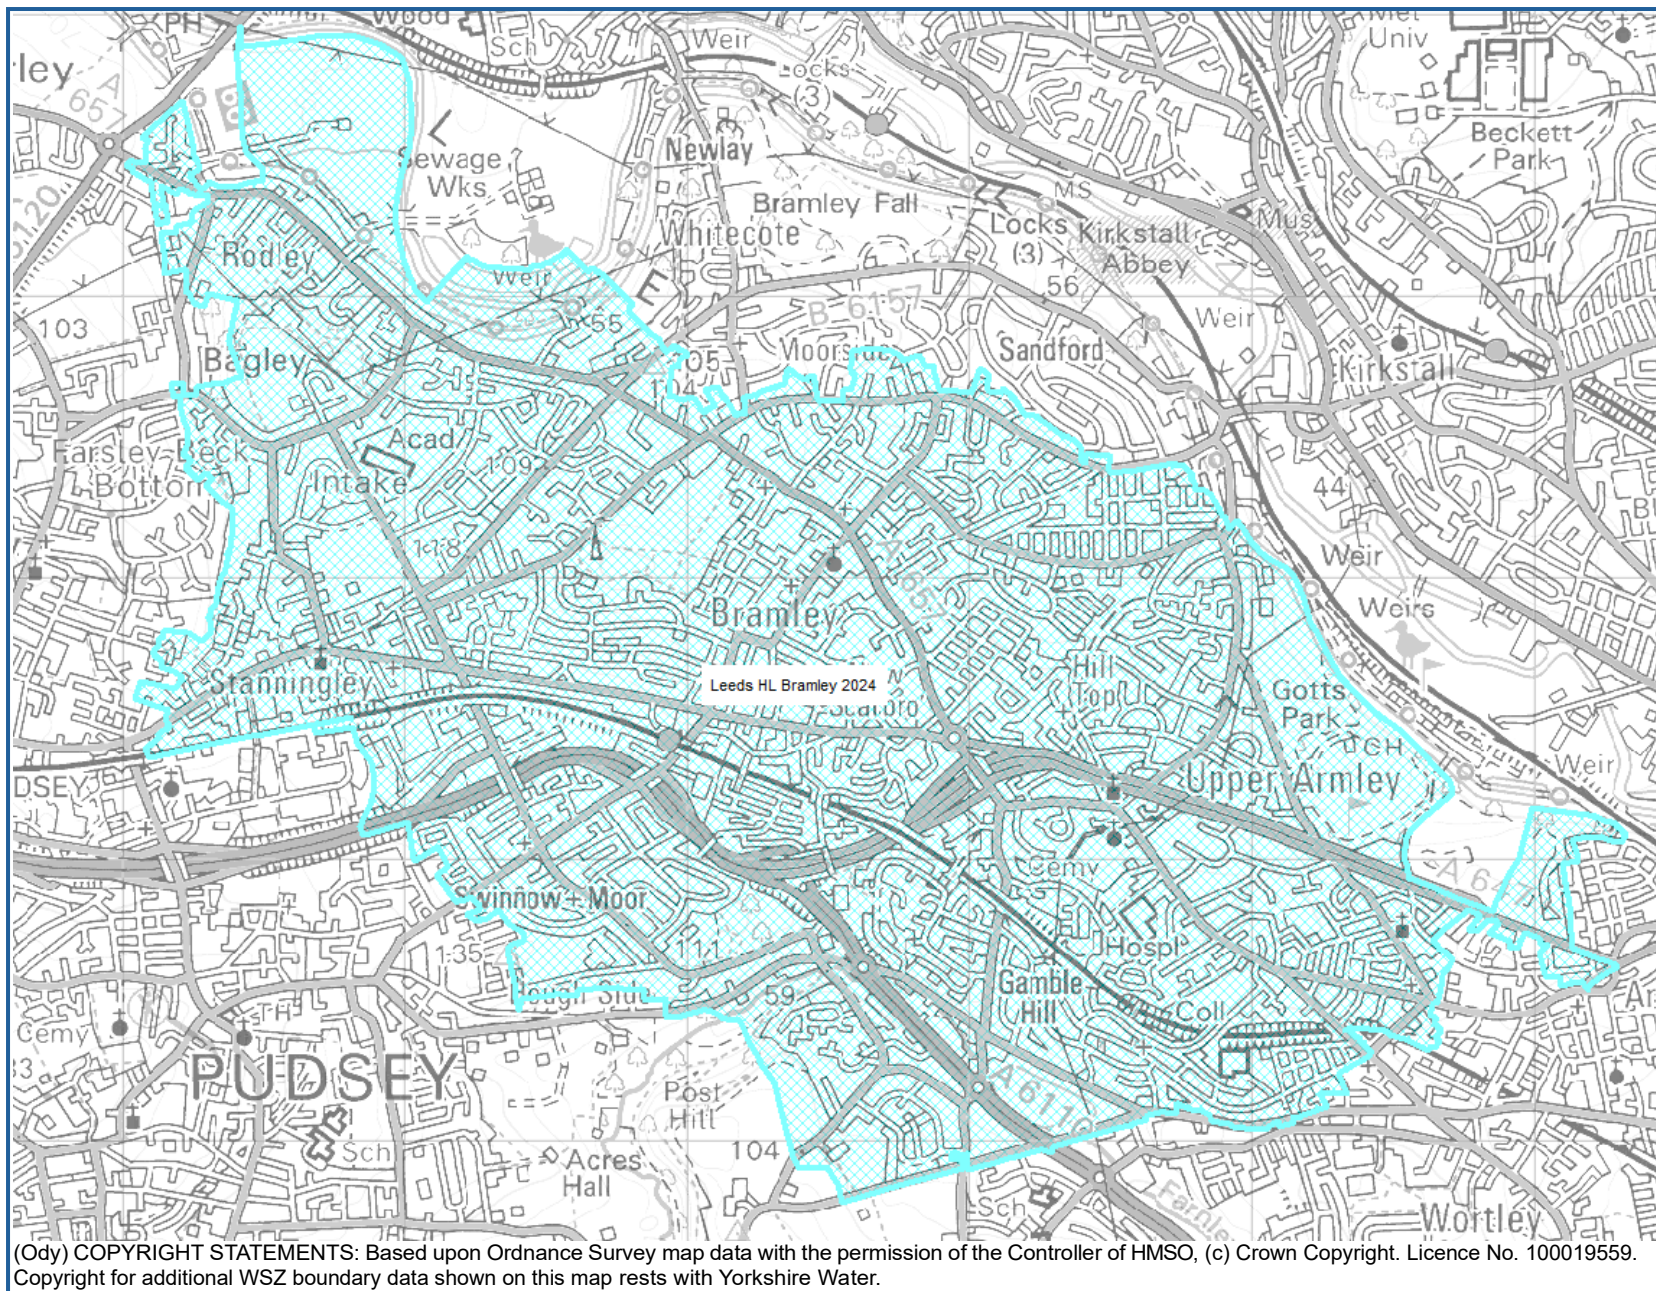

| Yorkshire Water Services            |           |                       | Reporting Period: 01-01-2024 to 31-12-2024 |                        |             |         |                      |                  |           |          |         |
|-------------------------------------|-----------|-----------------------|--------------------------------------------|------------------------|-------------|---------|----------------------|------------------|-----------|----------|---------|
| Water Supply Zone:                  |           | Leeds HL Bramley 2024 |                                            | Population             |             |         |                      | 50279            |           |          |         |
| ParameterName:                      | Std       | Und Std               | Units                                      | No of Samples<br>taken | No of Fails | % Fails | No of Fails<br>(Und) | % Fails<br>(Und) | Min       | Mean     | Max     |
| Colony Counts After 3 Days At 22øc  | -         |                       | no/ml                                      | 52                     | 0           | 0.00%   | 0                    | 0.00%            | 0         | 1.5      | 42      |
| E. coli                             | 0         |                       | no'/100 ml                                 | 132                    | 0           | 0.00%   | 0                    | 0.00%            | 0         | 0        | 0       |
| Enterococci                         | 0         |                       | no'/100 ml                                 | 8                      | 0           | 0.00%   | 0                    | 0.00%            | 0         | 0        | 0       |
| Residual Disinfectant - Free        | -         |                       | mg/l                                       | 132                    | 0           | 0.00%   | 0                    | 0.00%            | 0         | 0.26     | 0.69    |
| Residual Disinfectant - Total       | -         |                       | mg/l                                       | 132                    | 0           | 0.00%   | 0                    | 0.00%            | 0.04      | 0.36     | 0.78    |
| Total coliforms(Indicator)          | 0         |                       | no'/100 ml                                 | 132                    | 0           | 0.00%   | 0                    | 0.00%            | 0         | 0        | 0       |
| 1,2 Dichloroethane                  | 3         |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.16 <    | 0.2 <    | 0.16    |
| Aluminium                           | 200       |                       | µg Al/l                                    | 52                     | 0           | 0.00%   | 0                    | 0.00% <          | 5.83 <    | 10.788   | 16.6    |
| Ammonium(ammonia and ammonium ions) | 0.5       |                       | mg NH4/l                                   | 52                     | 0           | 0.00%   | 0                    | 0.00% <          | 0.008 <   | 0.0098   | 0.031   |
| Antimony                            | 5         |                       | µg Sb/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00%            | 0.08      | 0.1188   | 0.15    |
| Arsenic                             | 10        |                       | µg As/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.13 <    | 0.1575   | 0.21    |
| Benzene                             | 1         |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.06 <    | 0.06 <   | 0.06    |
| Benzo 3,4 pyrene                    | 0.01      |                       | ug/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.00042 < | 0.0004 < | 0.00042 |
| Boron                               | 1         |                       | mg B/l                                     | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.032 <   | 0.032 <  | 0.032   |
| Bromate                             | 10        |                       | µg BrO3/l                                  | 8                      | 0           | 0.00%   | 0                    | 0.00%            | 0.5       | 0.9375   | 1.5     |
| Cadmium                             | 5         |                       | µg Cd/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.03 <    | 0.0312   | 0.04    |
| Chloride                            | 250       |                       | mg Cl/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00%            | 7         | 10.7375  | 14.9    |
| Chromium                            | 50        |                       | µg Cr/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.05 <    | 0.1637   | 0.18    |
| Colour                              | 20        |                       | mg/l Pt/Co scale                           | 52                     | 0           | 0.00%   | 0                    | 0.00% <          | 3 <       | 3 <      | 3       |
| Conductivity                        | 2500      |                       | µS/cm                                      | 52                     | 0           | 0.00%   | 0                    | 0.00%            | 151       | 281.63   | 361     |
| Copper                              | 2         |                       | mg Cu/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.0004 <  | 0.0491   | 0.361   |
| Cyanide                             | 50        |                       | µg CN/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 1.2 <     | 1.2 <    | 1.2     |
| Fluoride                            | 1.5       |                       | mg F/l                                     | 8                      | 0           | 0.00%   | 0                    | 0.00%            | 0.04      | 0.066    | 0.09    |
| Hydrogen Ion (pH)                   | 6.5 - 9.5 |                       | pH value                                   | 52                     | 0           | 0.00%   | 0                    | 0.00%            | 7.02      | 7.23     | 7.62    |
| Iron                                | 200       |                       | µg Fe/l                                    | 52                     | 0           | 0.00%   | 0                    | 0.00% <          | 3.72 <    | 15.98    | 157     |
| Lead                                | 10        |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.03 <    | 1.129    | 6.05    |
| Manganese                           | 50        |                       | µg Mn/l                                    | 52                     | 0           | 0.00%   | 0                    | 0.00% <          | 0.3 <     | 0.9      | 3.95    |
| Mercury                             | 1         |                       | µg Hg/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.022 <   | 0.043 <  | 0.06    |
| Nickel                              | 20        |                       | µg Ni/l                                    | 8                      | 0           | 0.00%   | 0                    | 0.00%            | 0.61      | 1.926    | 6.61    |
| Nitrate                             | 50        |                       | mg NO3/l                                   | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 2.13 <    | 4.335    | 8.19    |
| Nitrite - Consumer's Taps           | 0.5       |                       | mg/l NO2                                   | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.002 <   | 0.0023 < | 0.003   |

| Yorkshire Water Services                |      |                       | Reporting Period: 01-01-2024 to 31-12-2024 |               |             |         |             |         |         |          |       |
|-----------------------------------------|------|-----------------------|--------------------------------------------|---------------|-------------|---------|-------------|---------|---------|----------|-------|
| Water Supply Zone:                      |      | Leeds HL Bramley 2024 |                                            | Population    |             |         |             | 50279   |         |          |       |
| ParameterName:                          | Std  | Und Std               | Units                                      | No of Samples | No of Fails | % Fails | No of Fails | % Fails | Min     | Mean     | Max   |
|                                         |      |                       |                                            | taken         |             |         | (Und)       | (Und)   |         |          |       |
| Nitrite/ Nitrate formula                | 1    |                       | mg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00%   | 0       | 0.075    | 0.16  |
| Odour                                   | 0    |                       | dilution number                            | 52            | 0           | 0.00%   | 0           | 0.00%   | 0       | 0        | 0     |
| Polycyclic Aromatic Hydrocarbons (PAHs) | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00%   | 0       | 0        | 0     |
| Selenium                                | 10   |                       | µg Se/l                                    | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.08 <  | 0.29     | 0.32  |
| Sodium                                  | 200  |                       | mg Na/l                                    | 8             | 0           | 0.00%   | 0           | 0.00%   | 6.28    | 9.06     | 11.1  |
| Sulphate                                | 250  |                       | mg SO4/l                                   | 8             | 0           | 0.00%   | 0           | 0.00%   | 40.9    | 55.325   | 69.6  |
| Taste                                   | 0    |                       | dilution number                            | 52            | 0           | 0.00%   | 0           | 0.00%   | 0       | 0        | 0     |
| Tetrachloroethene/Trichlorethene - Sum  | 10   |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00%   | 0       | 0        | 0     |
| Tetrachloromethane                      | 3    |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.16 <  | 0.16 <   | 0.16  |
| Total organic carbon                    | -    |                       | mg C/l                                     | 8             | 0           | 0.00%   | 0           | 0.00%   | 1.2     | 1.793    | 2.27  |
| Total Trihalomethanes (THM's)           | 100  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00%   | 20.6    | 34.2962  | 59.51 |
| Turbidity                               | 4    |                       | NTU                                        | 52            | 0           | 0.00%   | 0           | 0.00% < | 0.07 <  | 0.16     | 0.31  |
| Calcium                                 | -    |                       | mg Ca/l                                    | 8             | 0           | 0.00%   | 0           | 0.00%   | 31.9    | 39.0625  | 44.5  |
| Magnesium                               | -    |                       | mg Mg/l                                    | 8             | 0           | 0.00%   | 0           | 0.00%   | 1.91    | 4.095    | 5.81  |
| Total Hardness                          | -    |                       | mg Ca/l                                    | 8             | 0           | 0.00%   | 0           | 0.00%   | 35.1    | 45.85    | 53.9  |
| 2,4,5-T                                 | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.013 < | 0.0137 < | 0.015 |
| 2,4-D                                   | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.01 <  | 0.0104 < | 0.011 |
| 2,4-DB                                  | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.01 <  | 0.0112 < | 0.012 |
| Aldrin                                  | 0.03 |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.008 < | 0.008 <  | 0.008 |
| Atrazine                                | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.006 < | 0.006 <  | 0.006 |
| Azoxystrobin                            | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.006 < | 0.006 <  | 0.006 |
| Bentazone                               | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.004 < | 0.0044 < | 0.005 |
| Bixafen                                 | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.012 < | 0.012 <  | 0.012 |
| Boscalid                                | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.008 < | 0.008 <  | 0.008 |
| Bromacil                                | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.011 < | 0.011 <  | 0.011 |
| Bromoxynil                              | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.007 < | 0.0081 < | 0.01  |
| Carbetamide                             | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.009 < | 0.009 <  | 0.009 |
| Chlormequat                             | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.008 < | 0.008 <  | 0.008 |
| Chlorpropham                            | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.005 < | 0.0075 < | 0.009 |
| Chlorpyrifos                            | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.008 < | 0.008 <  | 0.008 |
| Chlortoluron                            | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.005 < | 0.005 <  | 0.005 |
| Clomazone                               | 0.1  |                       | µg/l                                       | 8             | 0           | 0.00%   | 0           | 0.00% < | 0.007 < | 0.007 <  | 0.007 |

| Yorkshire Water Services |      |                       | Reporting Period: 01-01-2024 to 31-12-2024 |                        |             |         |                      |                  |         |          |       |
|--------------------------|------|-----------------------|--------------------------------------------|------------------------|-------------|---------|----------------------|------------------|---------|----------|-------|
| Water Supply Zone:       |      | Leeds HL Bramley 2024 |                                            | Population             |             |         |                      | 50279            |         |          |       |
| ParameterName:           | Std  | Und Std               | Units                                      | No of Samples<br>taken | No of Fails | % Fails | No of Fails<br>(Und) | % Fails<br>(Und) | Min     | Mean     | Max   |
| Clopyralid               | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.011 < | 0.0125   | 0.016 |
| Cyanazine                | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.007 < | 0.007 <  | 0.007 |
| Cypermethrin             | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.008 < | 0.008 <  | 0.008 |
| Cyproconazole            | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.006 < | 0.006 <  | 0.006 |
| Diazinon                 | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.007 < | 0.007 <  | 0.007 |
| Dicamba                  | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.011 < | 0.0114 < | 0.012 |
| Dichlobenil              | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.004 < | 0.004 <  | 0.004 |
| Dichlorprop              | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.006 < | 0.0075 < | 0.01  |
| Dieldrin                 | 0.03 |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.009 < | 0.009 <  | 0.009 |
| Difenconazole            | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.009 < | 0.009 <  | 0.009 |
| Diiflufenican            | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.009 < | 0.009 <  | 0.009 |
| Diuron                   | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.009 < | 0.009 <  | 0.009 |
| Epoxiconazole            | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.006 < | 0.006 <  | 0.006 |
| EPTC                     | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.022 < | 0.022 <  | 0.022 |
| Flufenacet               | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.008 < | 0.008 <  | 0.008 |
| Fluroxypyr               | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.008 < | 0.0099 < | 0.011 |
| Flurtamone               | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.007 < | 0.007 <  | 0.007 |
| Flusilazole              | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.009 < | 0.009 <  | 0.009 |
| Flutriafol               | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.005 < | 0.005 <  | 0.005 |
| Fluxapyroxad             | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.01 <  | 0.01 <   | 0.01  |
| Gamma-HCH (Lindane)      | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.005 < | 0.005 <  | 0.005 |
| Heptachlor               | 0.03 |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.005 < | 0.005 <  | 0.005 |
| Heptachlor epoxide       | 0.03 |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.007 < | 0.007 <  | 0.007 |
| Imazapyr                 | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.004 < | 0.0052 < | 0.006 |
| Ioxynil                  | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.004 < | 0.0044 < | 0.005 |
| Isoproturon              | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.005 < | 0.005 <  | 0.005 |
| Linuron                  | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.009 < | 0.009 <  | 0.009 |
| MCPA                     | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.006 < | 0.0072 < | 0.008 |
| Mecoprop-P               | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.009 < | 0.0096 < | 0.01  |
| Mepiquat chloride        | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.008 < | 0.008 <  | 0.008 |
| Metaldehyde              | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.006 < | 0.006 <  | 0.006 |
| Metamitron               | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.008 < | 0.008 <  | 0.008 |
| Metazachlor              | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.005 < | 0.005 <  | 0.005 |
| Metobromuron             | 0.1  |                       | µg/l                                       | 8                      | 0           | 0.00%   | 0                    | 0.00% <          | 0.01 <  | 0.01 <   | 0.01  |

| Yorkshire Water Services      |     |                       | Reporting Period: 01-01-2024 to 31-12-2024 |                     |             |         |                   |               |         |          |       |
|-------------------------------|-----|-----------------------|--------------------------------------------|---------------------|-------------|---------|-------------------|---------------|---------|----------|-------|
| Water Supply Zone:            |     | Leeds HL Bramley 2024 |                                            | Population          |             |         |                   |               | 50279   |          |       |
| ParameterName:                | Std | Und Std               | Units                                      | No of Samples taken | No of Fails | % Fails | No of Fails (Und) | % Fails (Und) | Min     | Mean     | Max   |
| Monuron                       | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |
| op'-DDD (TDE)                 | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |
| op'-DDE                       | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |
| op'-DDT                       | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.004 < | 0.004 <  | 0.004 |
| Oxadixyl                      | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.012 < | 0.012 <  | 0.012 |
| Pendimethalin                 | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.009 < | 0.009 <  | 0.009 |
| Pesticides - Total Substances | 0.5 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00%         | 0       | 0.0042   | 0.016 |
| pp'-DDD (TDE)                 | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |
| pp'-DDE                       | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |
| pp'-DDT                       | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.004 < | 0.004 <  | 0.004 |
| Propachlor                    | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.007 < | 0.007 <  | 0.007 |
| Propamocarb                   | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.004 < | 0.0048 < | 0.006 |
| Propham                       | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |
| Propiconazole                 | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.009 < | 0.009 <  | 0.009 |
| Propyzamide                   | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.009 < | 0.009 <  | 0.009 |
| Prosulfocarb                  | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.006 < | 0.006 <  | 0.006 |
| Prothioconazole-desthio       | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.007 < | 0.007 <  | 0.007 |
| Quinmerac                     | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.006 < | 0.006 <  | 0.006 |
| Simazine                      | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |
| Tebuconazole                  | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.006 < | 0.006 <  | 0.006 |
| Tri-allate                    | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.006 < | 0.006 <  | 0.006 |
| Trichlopyr                    | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.016 < | 0.0179 < | 0.019 |
| Trietazine                    | 0.1 |                       | µg/l                                       | 8                   | 0           | 0.00%   | 0                 | 0.00% <       | 0.005 < | 0.005 <  | 0.005 |

- Notes:**
- 1) Qualified values are taken at face value in all calculations.
  - 2) Any infringements of the regulatory standard are thoroughly investigated and are reported to the Drinking Water Inspectorate (DWI), with remedial actions put in place where necessary.
  - 3) Details of undertakings and notices (Improvement programmes) applicable can be obtained from the DWI website: [Yorkshire Water Improvement Programmes - Drinking Water Inspectorate](#)